
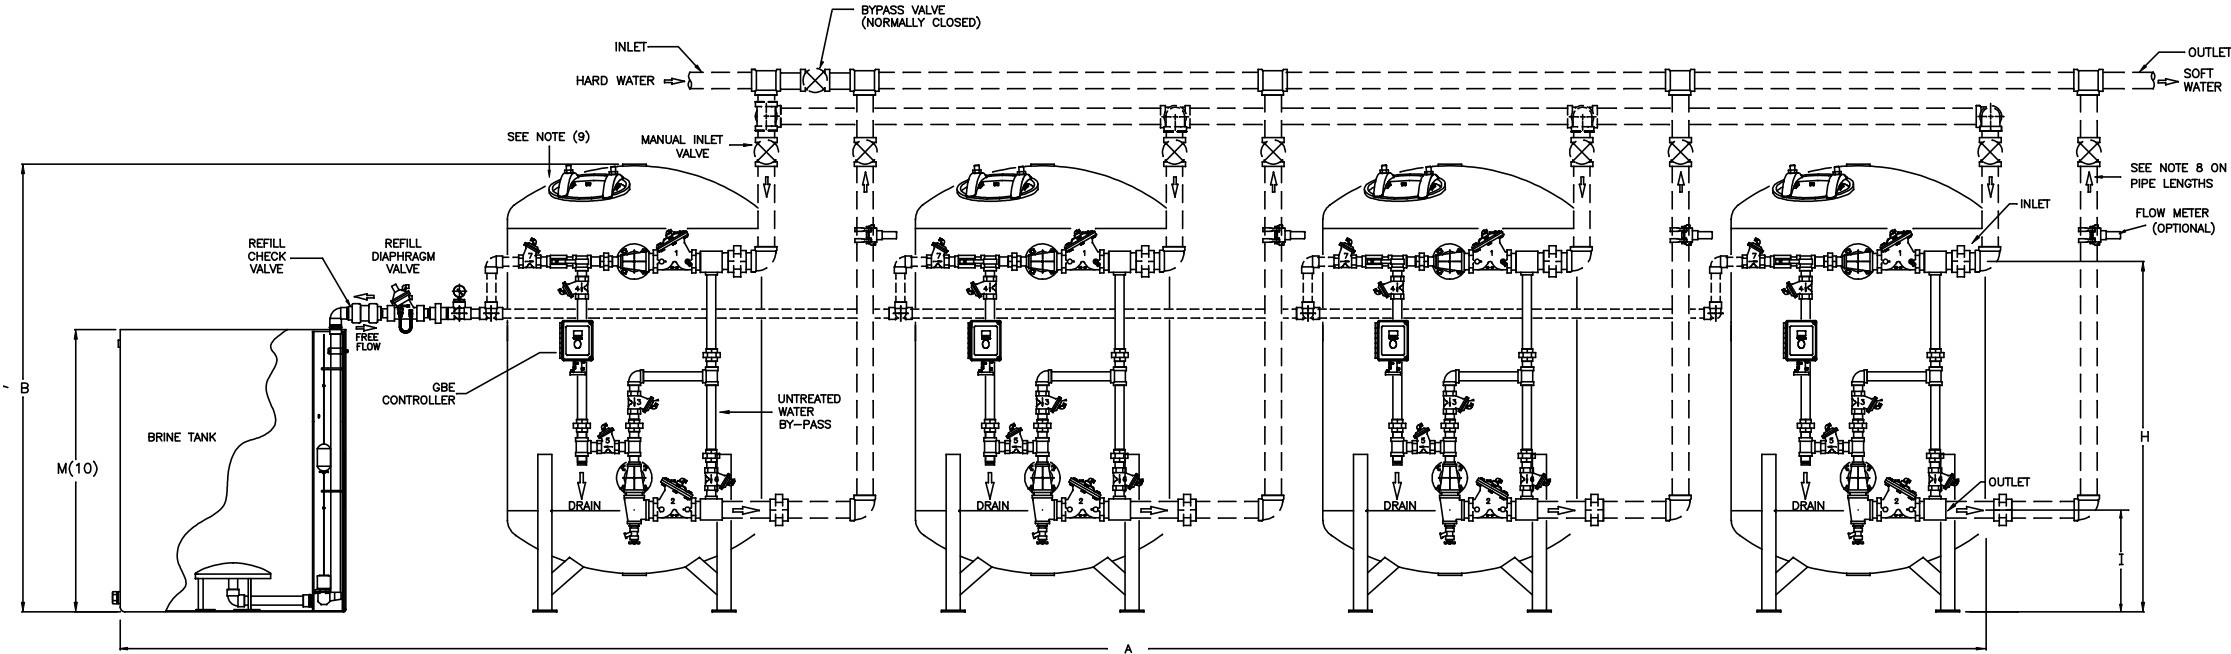
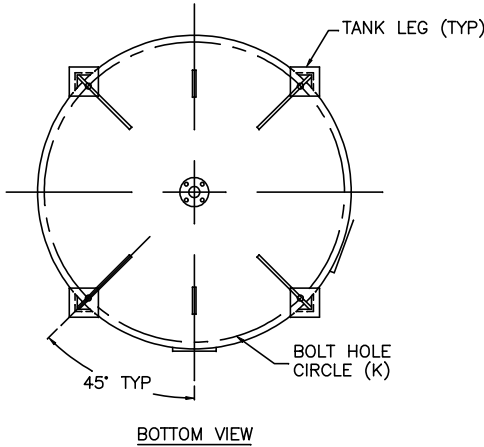


NOTES:

- (1) ITEMS SHOWN IN BROKEN LINES TO BE FURNISHED BY OTHERS.
- (2) ALL DIMENSIONS ARE ± 1 INCH (25mm) AND SUBJECT TO CHANGE WITHOUT NOTICE.
- (3) UNIONS SHOULD BE LOCATED ON INLET AND OUTLET CONNECTIONS OF HARNESS TO FACILITATE SERVICING.
- (4) THE USE OF DISSIMILAR METALS IN A PIPING SYSTEM IS NOT RECOMMENDED. WHERE DISSIMILAR METALS MUST BE CONNECTED IN A WATER SYSTEM. THE USE OF NONCONDUCTIVE (DIELECTRIC) FITTINGS MAY REDUCE GALVANIC CORROSION.
- (5) AN ELECTRICAL OUTLET SHOULD BE PROVIDED WITHIN FIVE FEET OF THE EQUIPMENT LOCATION.
- (6) ALLOW A MINIMUM OF 24 INCHES ABOVE SOFTENER FOR FILLING.
- (7) TO PERMIT THE OBSERVATION OF THE DRAIN FLOW DO NOT MAKE A DIRECT CONNECTION TO THE DRAIN. PROVIDE AN AIR GAP OF AT LEAST FOUR TIMES THE DIAMETER OF THE DRAIN PIPE OR CONFORM TO LOCAL SANITATION CODES.
- (8) WHEN USING A WATER METER, THERE MUST BE A MINIMUM AMOUNT OF STRAIGHT PIPE BEFORE AND AFTER THE SENSOR. REFER TO THE INSTALLATION INSTRUCTIONS FOR DETAILS.
- (9) ACCESS OPENINGS SHOWN ON TANK ARE FOR REFERENCE ONLY. QUANTITY, TYPE AND PLACEMENT ARE DEPENDENT ON TANK SIZE.
- (10) BRINE TANK DIMENSIONS SHOWN ARE FOR THE BRINE TANK MOST COMMONLY SELECTED FOR USE WITH THIS SIZE SYSTEM

	DIMENSIONS (INCHES)														UNIT DATA PER TANK							
MODEL	WIDTH A	HEIGHT B	DEPTH C	TANK DIA. D	SIDE-SHELL E	INLET/OUTLET PIPE SIZES F	DRAIN SIZE G	FLOOR TO INLET H	FLOOR TO OUTLET I	BACK TO INLET/OUTLET J	BOLT HOLE CIRCLE K	BRINE TANK DIA. L(10)	BRINE TANK HEIGHT M(10)	INLET/ OUTLET OFFSET N	MAX. CAPACITY KGR @ SALT DOSAGE	RESIN VOLUME ft <sup>3</sup>	CONTINUOUS FLOW gpm @ psi drop	PEAK FLOW gpm @ psi drop	DRAIN FLOW gpm	MIN. DRAIN PIPE SIZE IN.	TRIPLEX OPER. WT. lbs.	TRIPLEX SHIP. WT. lbs.
HS-1203	357	93	60.5	48	60	3.0	1.5	73.25	20.6	55.0	45.7	48	60	18.75	1200 @ 600	40	150 @ 8	230 @ 15	60	2.0	44000	23200
HS-1503	381	96	66.5	54	60	3.0	1.5	78.5	21.7	61.0	51.7	48	60	18.75	1500 @ 750	50	160 @ 7	230 @ 14	70	2.0	54400	29600

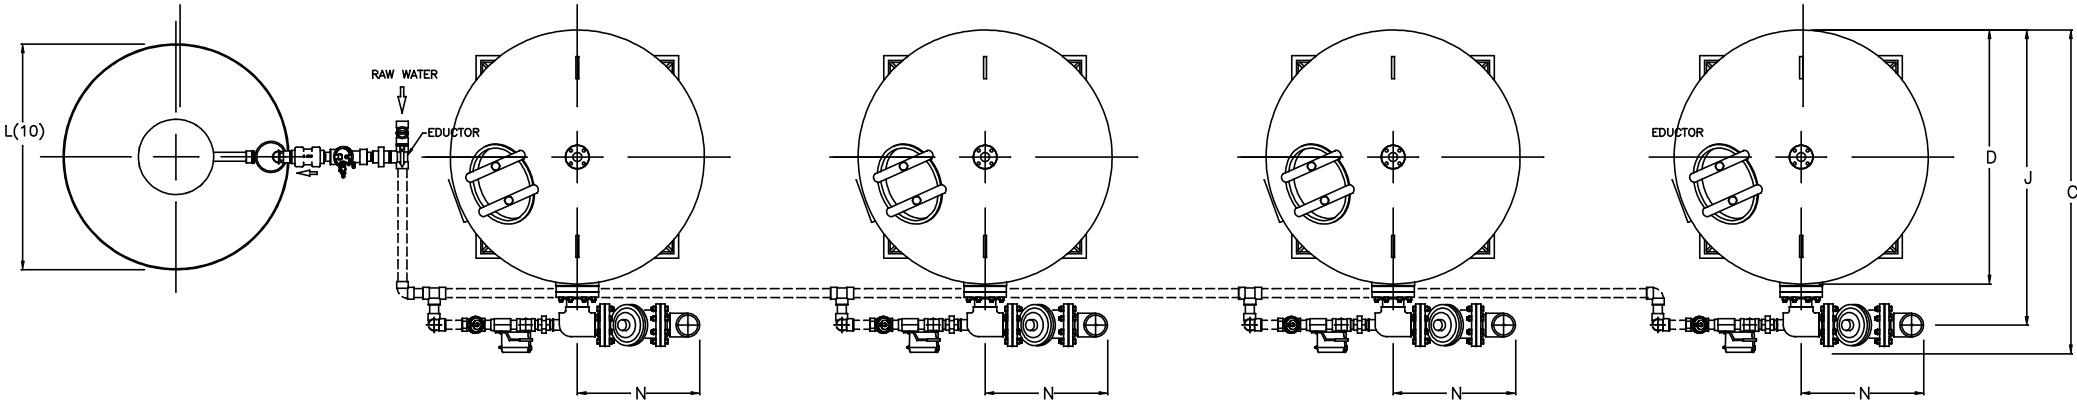

DO NOT SCALE DRAWING TOLERANCES: ±1/8" UNLESS OTHERWISE NOTED				
Let.	Change	By	App	Date

**Culligan®**  
*ENGINEERED SYSTEMS*  
ROSEMONT, ILLINOIS



PRINT AND BILL OF MATERIAL ARE NOT  
TO BE USED WITHOUT THE WRITTEN  
CONSENT OF CULLIGAN INTERNATIONAL CO.

NAME HI-FLO 50 SOFTENERS MODELS - 1203 & 1503 TECHNICAL DATA SHEET		
DETAILED BY: KMR 12/17/07	APP. BY: KSR 01/12/10	SHEET 1 OF 1
REF. NO.	PART NO. HF-50-3_Tech_QUAD	

NOTES:

- (1) ITEMS SHOWN IN BROKEN LINES TO BE FURNISHED BY OTHERS.
- (2) ALL DIMENSIONS ARE ± 1 INCH (25mm) AND SUBJECT TO CHANGE WITHOUT NOTICE.
- (3) UNIONS SHOULD BE LOCATED ON INLET AND OUTLET CONNECTIONS OF HARNESS TO FACILITATE SERVICING.
- (4) THE USE OF DISSIMILAR METALS IN A PIPING SYSTEM IS NOT RECOMMENDED. WHERE DISSIMILAR METALS MUST BE CONNECTED IN A WATER SYSTEM. THE USE OF NONCONDUCTIVE (DIELECTRIC) FITTINGS MAY REDUCE GALVANIC CORROSION.
- (5) AN ELECTRICAL OUTLET SHOULD BE PROVIDED WITHIN FIVE FEET OF THE EQUIPMENT LOCATION.
- (6) ALLOW A MINIMUM OF 24 INCHES ABOVE SOFTENER FOR FILLING.
- (7) TO PERMIT THE OBSERVATION OF THE DRAIN FLOW DO NOT MAKE A DIRECT CONNECTION TO THE DRAIN. PROVIDE AN AIR GAP OF AT LEAST FOUR TIMES THE DIAMETER OF THE DRAIN PIPE OR CONFORM TO LOCAL SANITATION CODES.
- (8) WHEN USING A WATER METER, THERE MUST BE A MINIMUM AMOUNT OF STRAIGHT PIPE BEFORE AND AFTER THE SENSOR. REFER TO THE INSTALLATION INSTRUCTIONS FOR DETAILS.
- (9) ACCESS OPENINGS SHOWN ON TANK ARE FOR REFERENCE ONLY. QUANTITY, TYPE AND PLACEMENT ARE DEPENDENT ON TANK SIZE.
- (10) BRINE TANK DIMENSIONS SHOWN ARE FOR THE BRINE TANK MOST COMMONLY SELECTED FOR USE WITH THIS SIZE SYSTEM

MODEL	DIMENSIONS (INCHES)														UNIT DATA PER TANK							
	WIDTH A	HEIGHT B	DEPTH C	TANK DIA. D	SIDE-SHELL E	INLET/OUTLET PIPE SIZES F	DRAIN SIZE G	FLOOR TO INLET H	FLOOR TO OUTLET I	BACK TO INLET/OUTLET J	BOLT HOLE CIRCLE K	BRINE TANK DIA. L(10)	BRINE TANK HEIGHT M(10)	INLET/ OUTLET OFFSET N	MAX. CAPACITY KGR @ SALT DOSAGE	RESIN VOLUME ft <sup>3</sup>	CONTINUOUS FLOW gpm @ psi drop	PEAK FLOW gpm @ psi drop	DRAIN FLOW gpm	MIN. DRAIN PIPE SIZE IN.	TRIPLEX OPER. WT. lbs.	TRIPLEX SHIP. WT. lbs.
HS-1504	381	96	69	54	60	4.0	1.5	78.5	20.0	63.0	51.7	48	60	26	1500 @ 750	50	190 @ 6	320 @ 15	70	2.0	56900	31200
HS-2004	417	99	76	60	60	4.0	1.5	79.5	21.3	69.68	57.63	60	60	26	2000 @ 1005	67	240 @ 7	400 @ 18	90	2.0	71600	38400

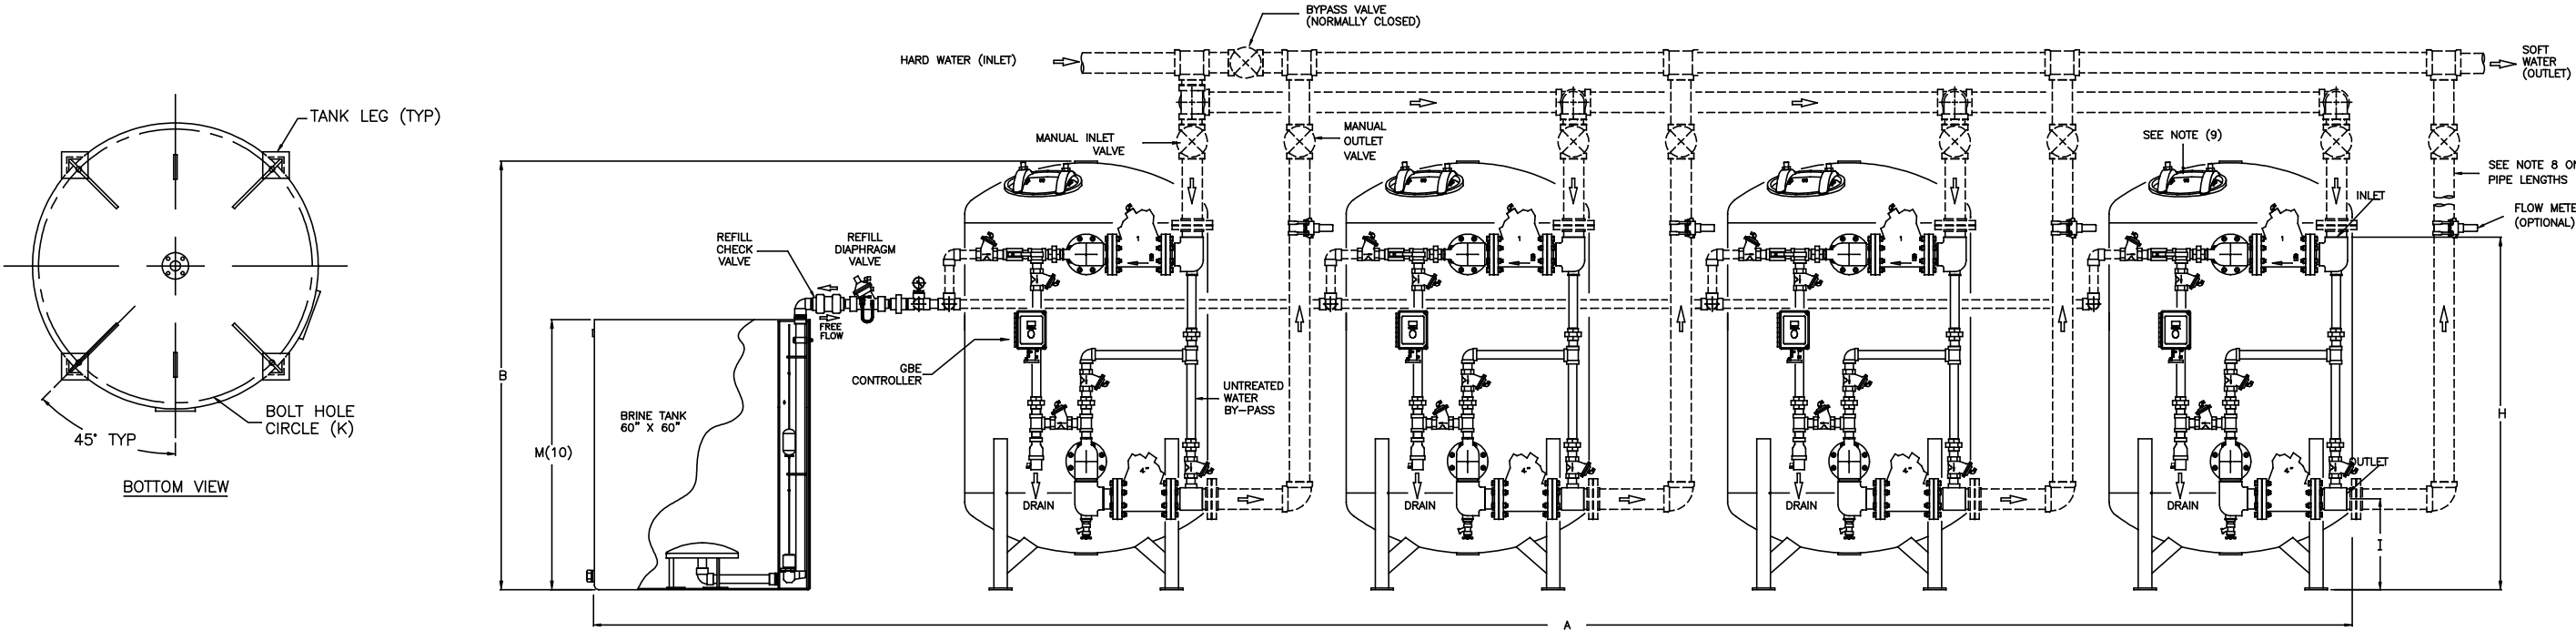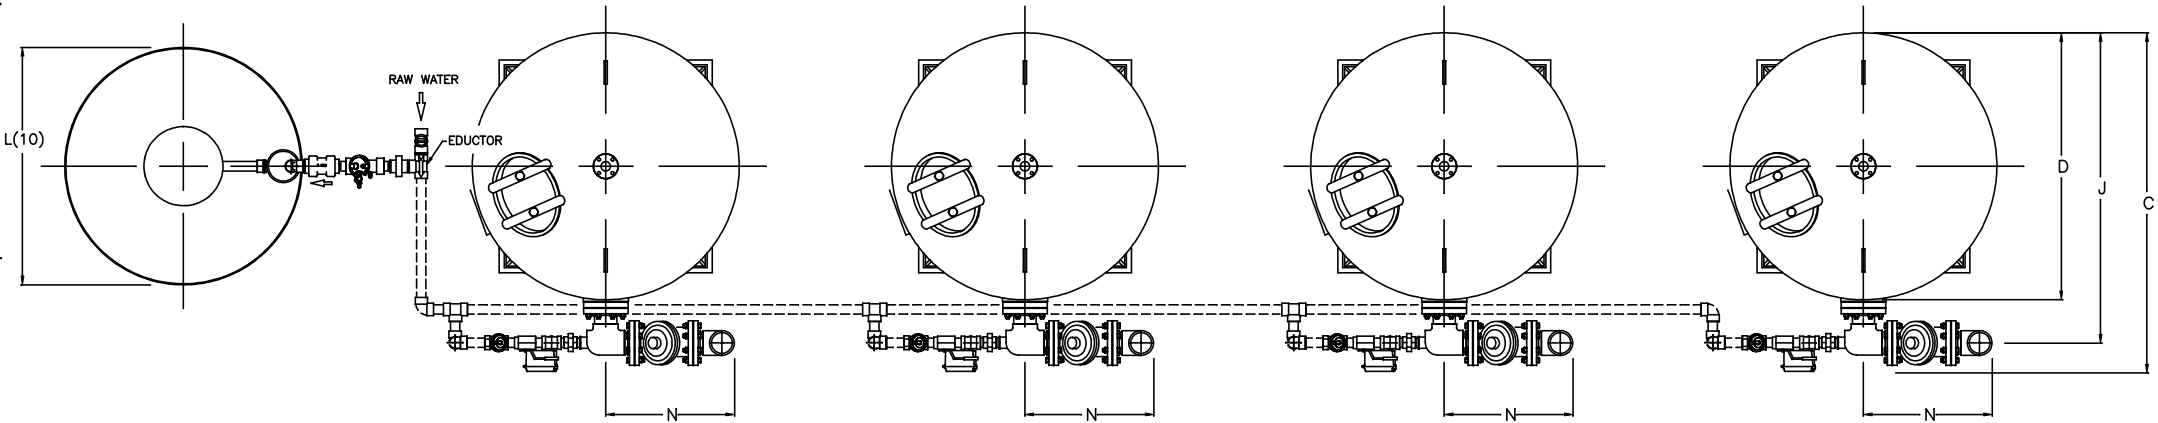

DO NOT SCALE DRAWING TOLERANCES: ±1/8" UNLESS OTHERWISE NOTED					 <b>ENGINEERED SYSTEMS</b> ROSEMONT, ILLINOIS  PRINT AND BILL OF MATERIAL ARE NOT TO BE USED WITHOUT THE WRITTEN CONSENT OF CULLIGAN INTERNATIONAL CO.	NAME HI-FLO 50 SOFTENERS MODELS - 1504 & 2004 TECHNICAL DATA SHEET		
Let.	Change	By	App	Date		DETAILED BY: KMR 12/17/07	APP. BY: KSR 01/12/10	SHEET 1 OF 1
						REF. NO.	PART NO.	
							HF-50-4_Tech_QUAD	